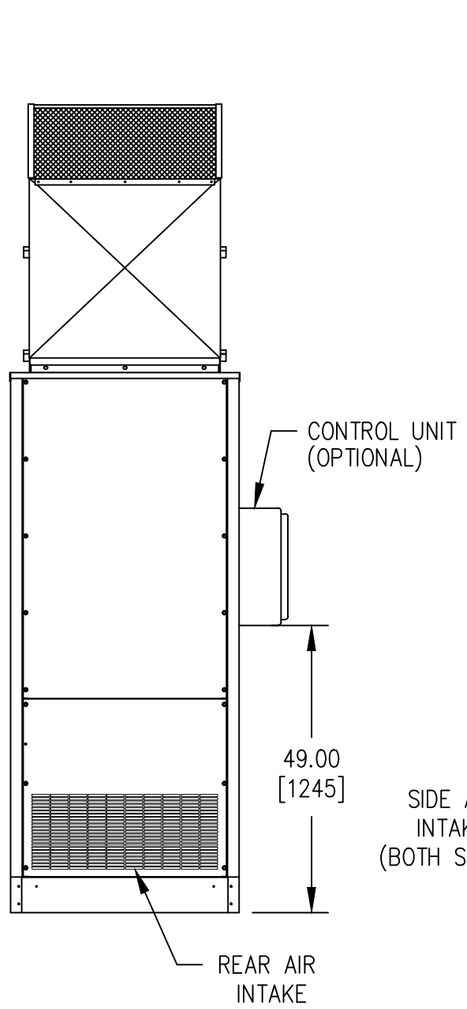

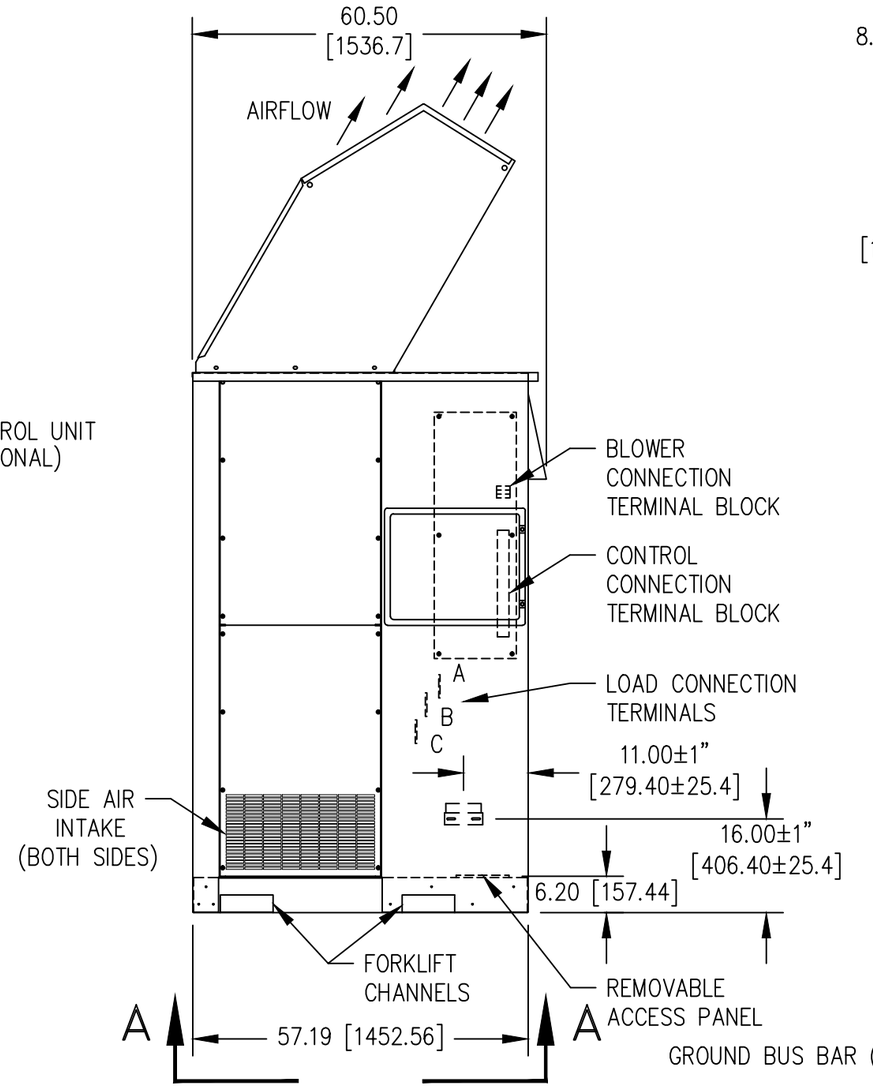

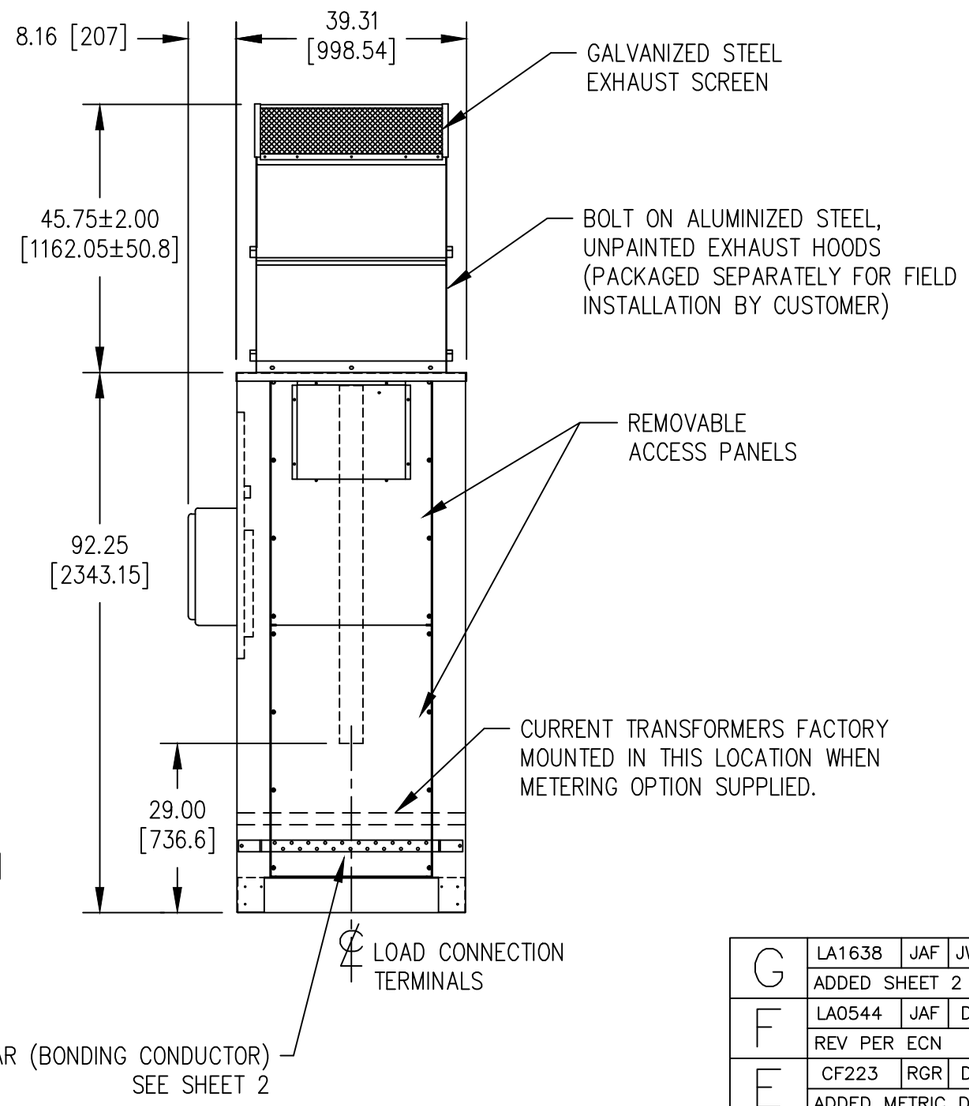

5. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS 6 FEET.
4. PROVIDE A CLEAR VERTICAL EXHAUST FIELD. REVIEW MANUAL FOR DETAILED INSTALLATION AND SITE CONDITIONS.
3. MAXIMUM INTAKE AIR TEMPERATURE IS 120°F. INTAKE AIR IS DRAWN IN FROM SIDES, END AND BOTTOM OF UNIT.
2. ALL DIMENSIONS ARE APPROX. IN INCHES [mm]
1. WEIGHT: 1500 LBS APPROX [680 Kg]

REV. TO SHEET	ECN NO.	BY	APP.	DATE
G	LA1638	JAF	JWE	11/3/14
	ADDED SHEET 2			
F	LA0544	JAF	DK	1/18/11
	REV PER ECN			
E	CF223	RGR	DK	4/17/08
	ADDED METRIC DIMS			
D	CD917	JAF	DK	1/7/05
	ADDED C.T. BKT. DIMS.			

FOR APPLICATION ENGINEERING USAGE ONLY

PROJECT NAME:

K875A LOAD BANK, OUTDOOR, (1) SINGLE BAY

THIRD ANGLE PROJECTION

	BY	DATE
DRAWN BY	JJF	5/4/98
CHECKED	JJF	5/4/98
PROJECT APPROVAL	DK	5/4/98
FINAL APPROVAL		

MANUFACTURING TOLERANCES TO BE IN ACCORDANCE WITH ASCO PROCEDURE MP-I-003. FOR PLASTIC PARTS SEE MP-I-055

ASSEM. REF. NO.

PROPERTY OF ASCO POWER TECHNOLOGIES. USE PERMITTED FOR OUR WORK ONLY. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.

ASCO® ASCO POWER TECHNOLOGIES, L.P.
FLORHAM PARK, NEW JERSEY 07932 U.S.A.

COMPUTER GENERATED DRAWING

SCALE 25.7 | SIZE BS

DWG. NO. SB2793

DRAWING REV. G | ECN NO. LA1638 | SHEET 1 OF 2

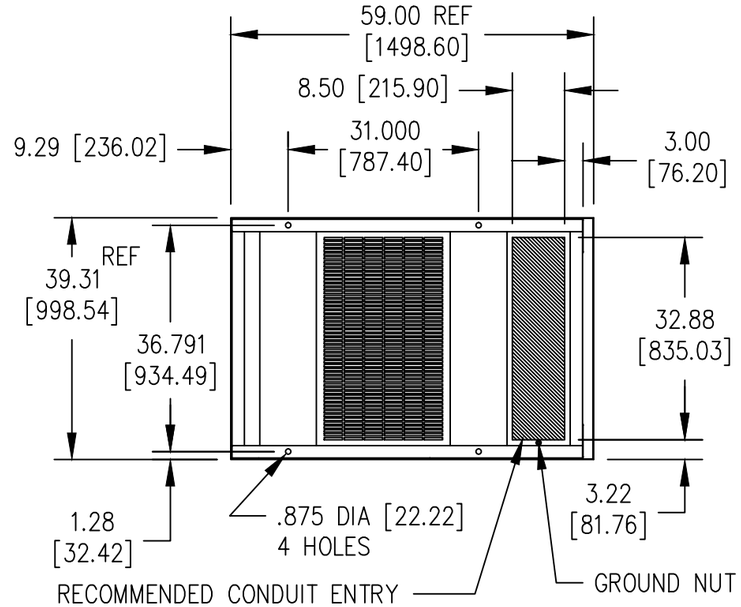

VIEW A–A

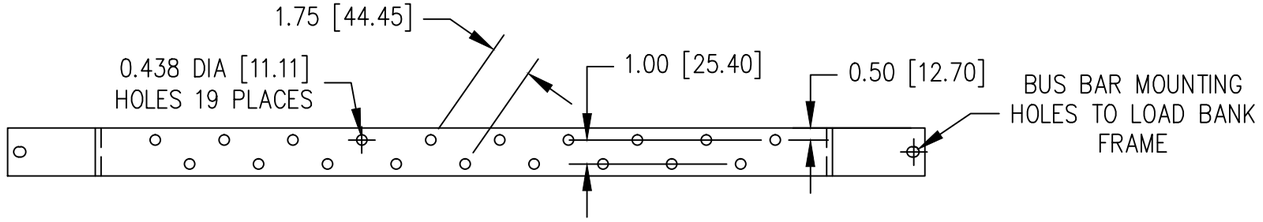

GROUND BUS BAR DETAIL

GROUND BUS BAR IS
0.25 [6.35] THICK COPPER

FOR APPLICATION ENGINEERING USAGE ONLY

REV. TO SHEET	ECN NO.	BY	APP.	DATE
G	LA1638	JAF	JWE	11/3/14
	ADDED THIS SHEET			

PROJECT NAME:

K875A LOAD BANK, OUTDOOR (1) SINGLE BAY

THIRD ANGLE PROJECTION

	BY	DATE
DRAWN BY	JJF	5/4/98
CHECKED	JJF	5/4/98
PROJECT APPROVAL	DK	5/4/98
FINAL APPROVAL		

MANUFACTURING TOLERANCES TO BE IN ACCORDANCE WITH ASCO PROCEDURE MP-I-003. FOR PLASTIC PARTS SEE MP-I-055

ASSEM. REF. NO.

PROPERTY OF ASCO POWER TECHNOLOGIES. USE PERMITTED FOR OUR WORK ONLY. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.

ASCO® ASCO POWER TECHNOLOGIES, L.P.
FLORHAM PARK, NEW JERSEY 07932 U.S.A.

COMPUTER GENERATED DRAWING

SCALE 24.5 | SIZE BS

DWG. NO. SB2793

DRAWING REV. G | ECN NO. LA1638 | SHEET 2 OF 2